



## Standard Operating Procedure for more than 650V under reg 32

By login at Single Window [www.investuttarakhand.com](http://www.investuttarakhand.com) , applicant clicks on Pre-Operation, select department & applies to the 'Application for approval of CEI prior to energization of electrical installation for voltage greater than 650V under regulation- 32' by filling in required details and uploading all documents

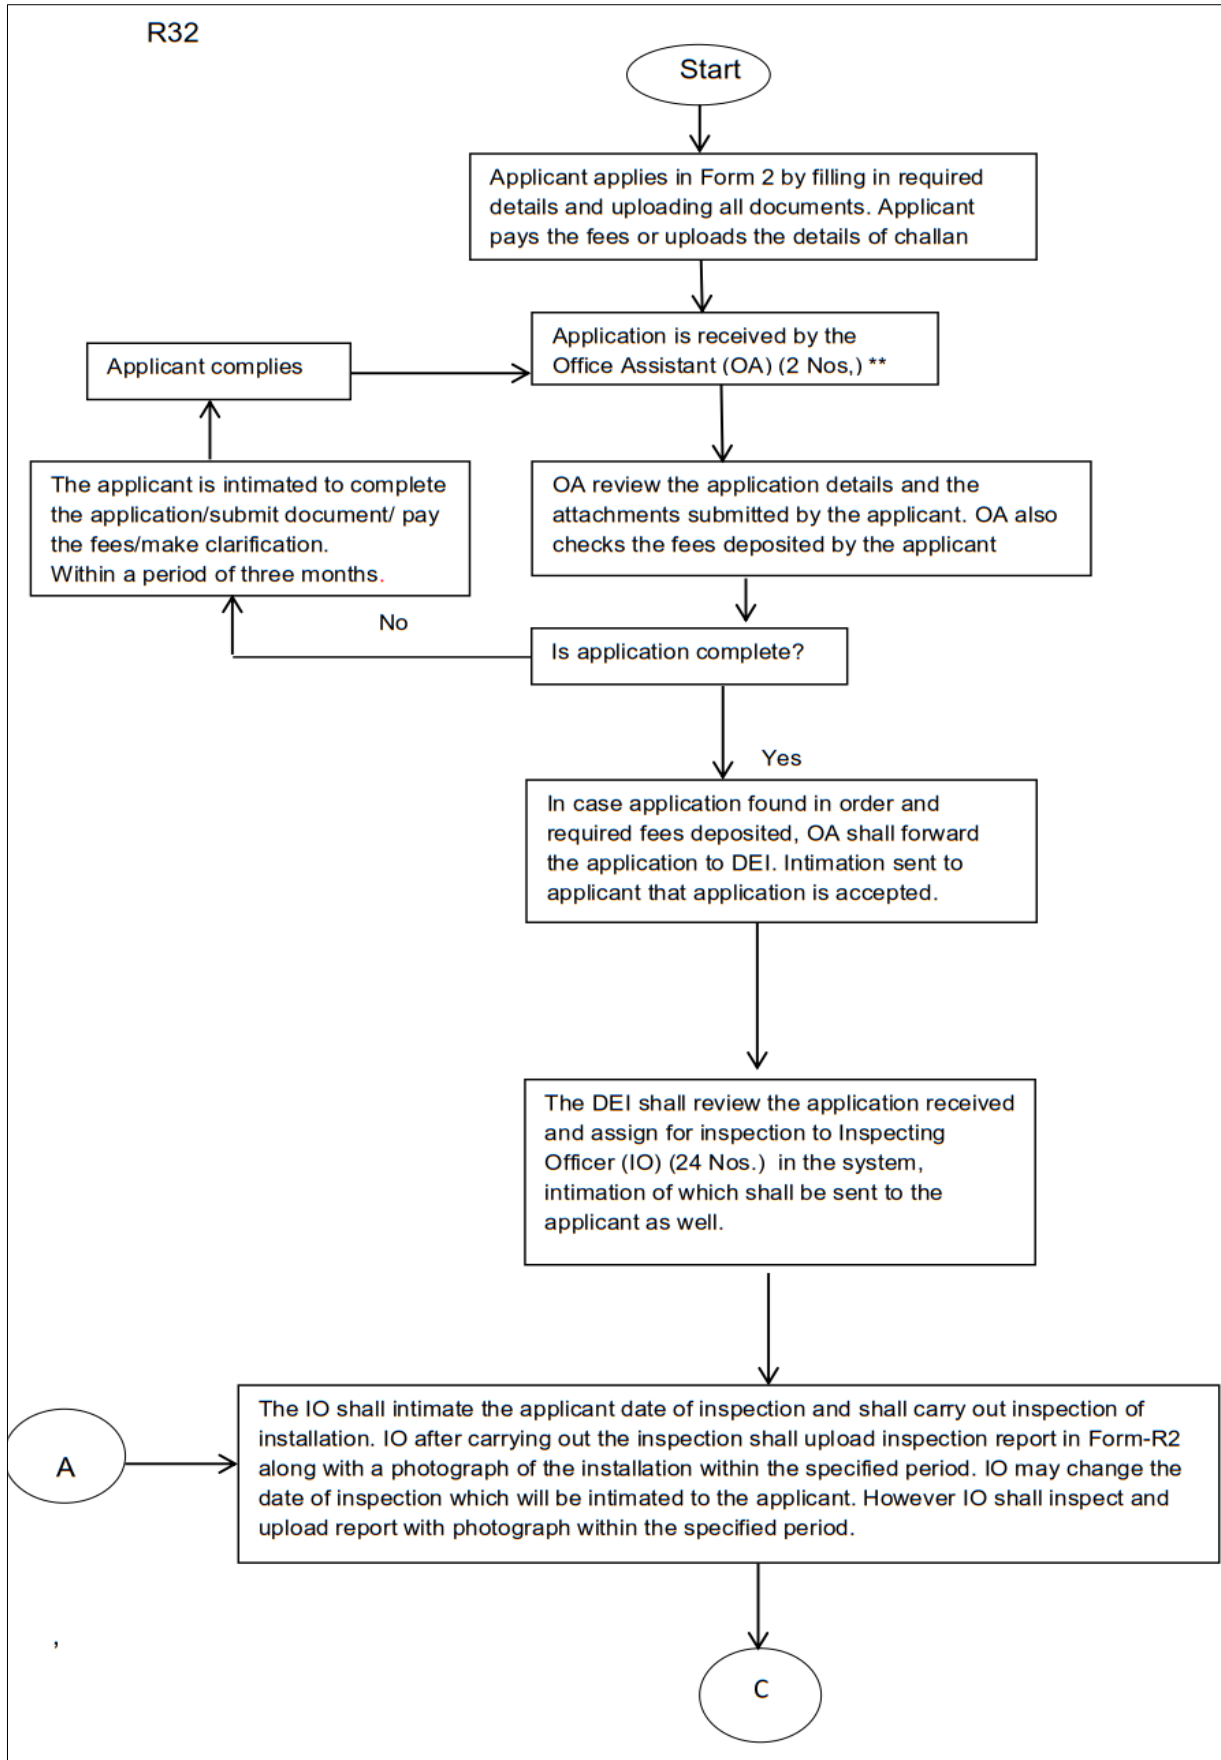

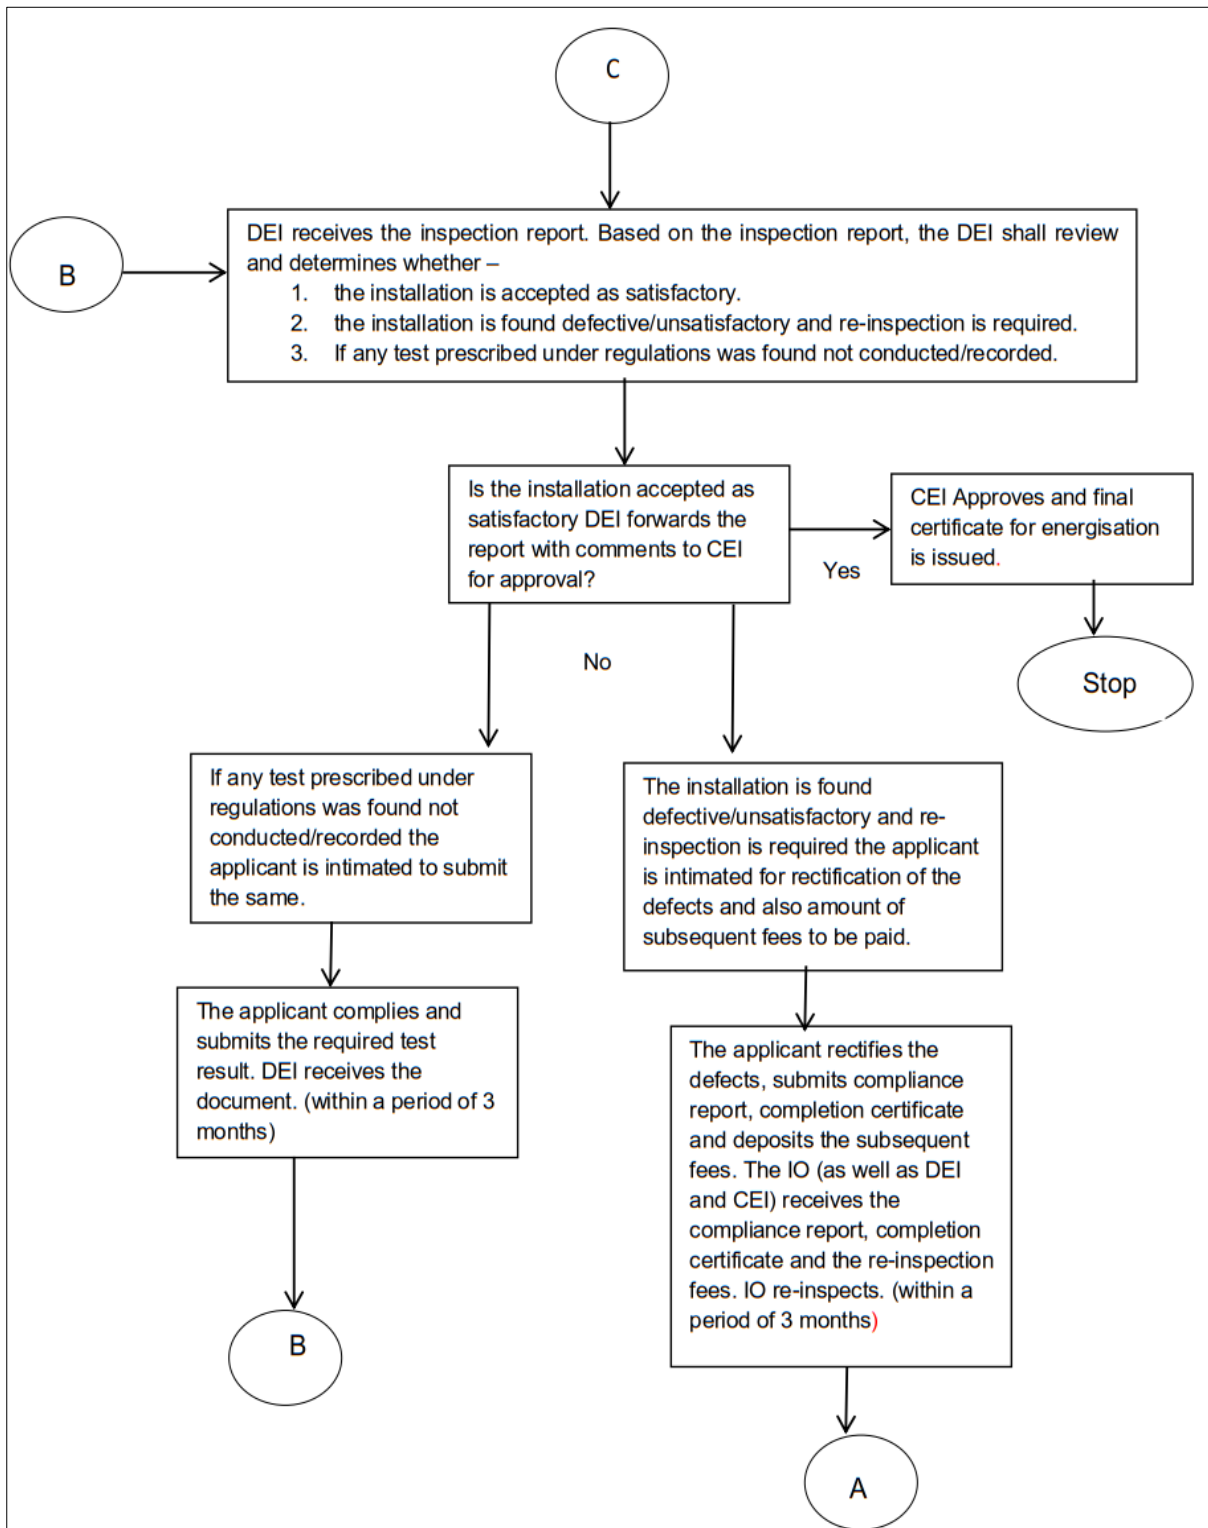

\*\* OA 1 – District-Almora, Nainital, Bageshwar, Champawat, Pithoragarh, Udham Singh Nagar  
 OA 2 – District – Dehradun, Tehri, Uttarkashi, Chamoli, Rudraprayag, Pauri Garhwal, Haridwar

**Note**

- 1- IO-24 No. (CEI-1, DEI(HQ)-1, DEI-2, AEI-5, AAEE(HQ)-1, AAEE-3, EJE-11
- 2- CEI and DEI(HQ) can re-allocate any application including themselves before inspection.